



TYPICAL CABLE TRENCH DETAIL
(1:10)

SAND BEDDING: FOR ALL OPEN TRENCHING, A GEO-SYNTHETIC SHEETING SHALL BE LAID PRIOR TO INSTALLATION OF THE SAND BEDDING, THAT SHALL BE IN ACCORDANCE WITH EA TS 97-1 SPECIAL BACKFILLING MATERIAL FOR CABLE INSTALLATIONS

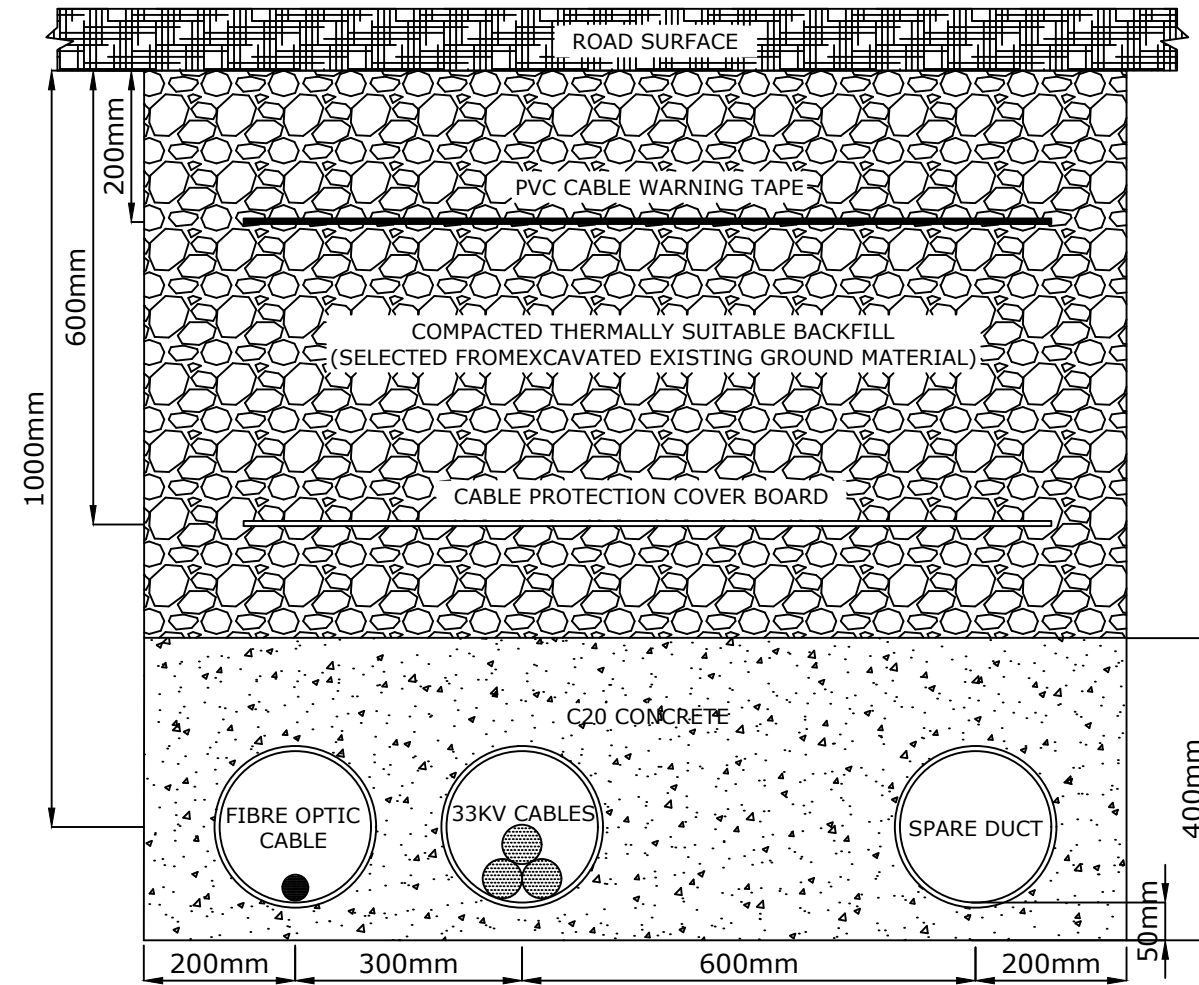

TYPICAL CABLE TRENCH DETAIL AT ROAD CROSSING
(1:10)



Legend:

Title: Figure 4.10 Typical Cable Trench Detail	
Limekiln Wind Farm S36C	
Source: © Crown copyright and database rights 2018 Ordnance Survey 0100031673	
Client: Infinergy	
Drawn by: DB	Checked: KC
Date: 06/05/21	
Scale: 1:10	Revision: -