

INDICATIVE LIGHTING AND CCTV COLUMN DETAILS



NOTES:

- 1. THIS DRAWING IS INDICATIVE FOR PLANNING PURPOSES ONLY.
- 2. FINAL SELECTION OF EQUIPMENT SUBJECT TO DETAILED DESIGN POST PLANNING PERMISSION.
- 3. 10 m HIGH LIGHTING COLUMNS IN SUBSTATION IDENTICAL TO THOSE ALREADY IN USE, TO BE USED FOR TASK LIGHTING ONLY AND NOT PERMANENT ILLUMINATION.
- 4. LIGHTING IN BESS AREA TO BE USED FOR SAFETY LIGHTING DURING MAINTENANCE AND FOR SECURITY LIGHTING WHEN SECURITY SYSTEM IS ARMED AND SHALL BE LOW LUX LEVEL GUIDANCE LIGHTING ONLY.
- 5. BESS AREA LIGHTING SHALL USE CCTV SYSTEM TO TRIGGER SECURITY LIGHTING TO LIMIT NUISANCE SWITCHING.

Title:
INDICATIVE LIGHTING AND CCTV
COLUMN DETAILS

Project:
LIMEKILN BESS


Source:

Client:

Drawn by:
SPD

Date:	Number:
JULY 2025	16

Scale:	Revision no:
1:50 @ A3	1

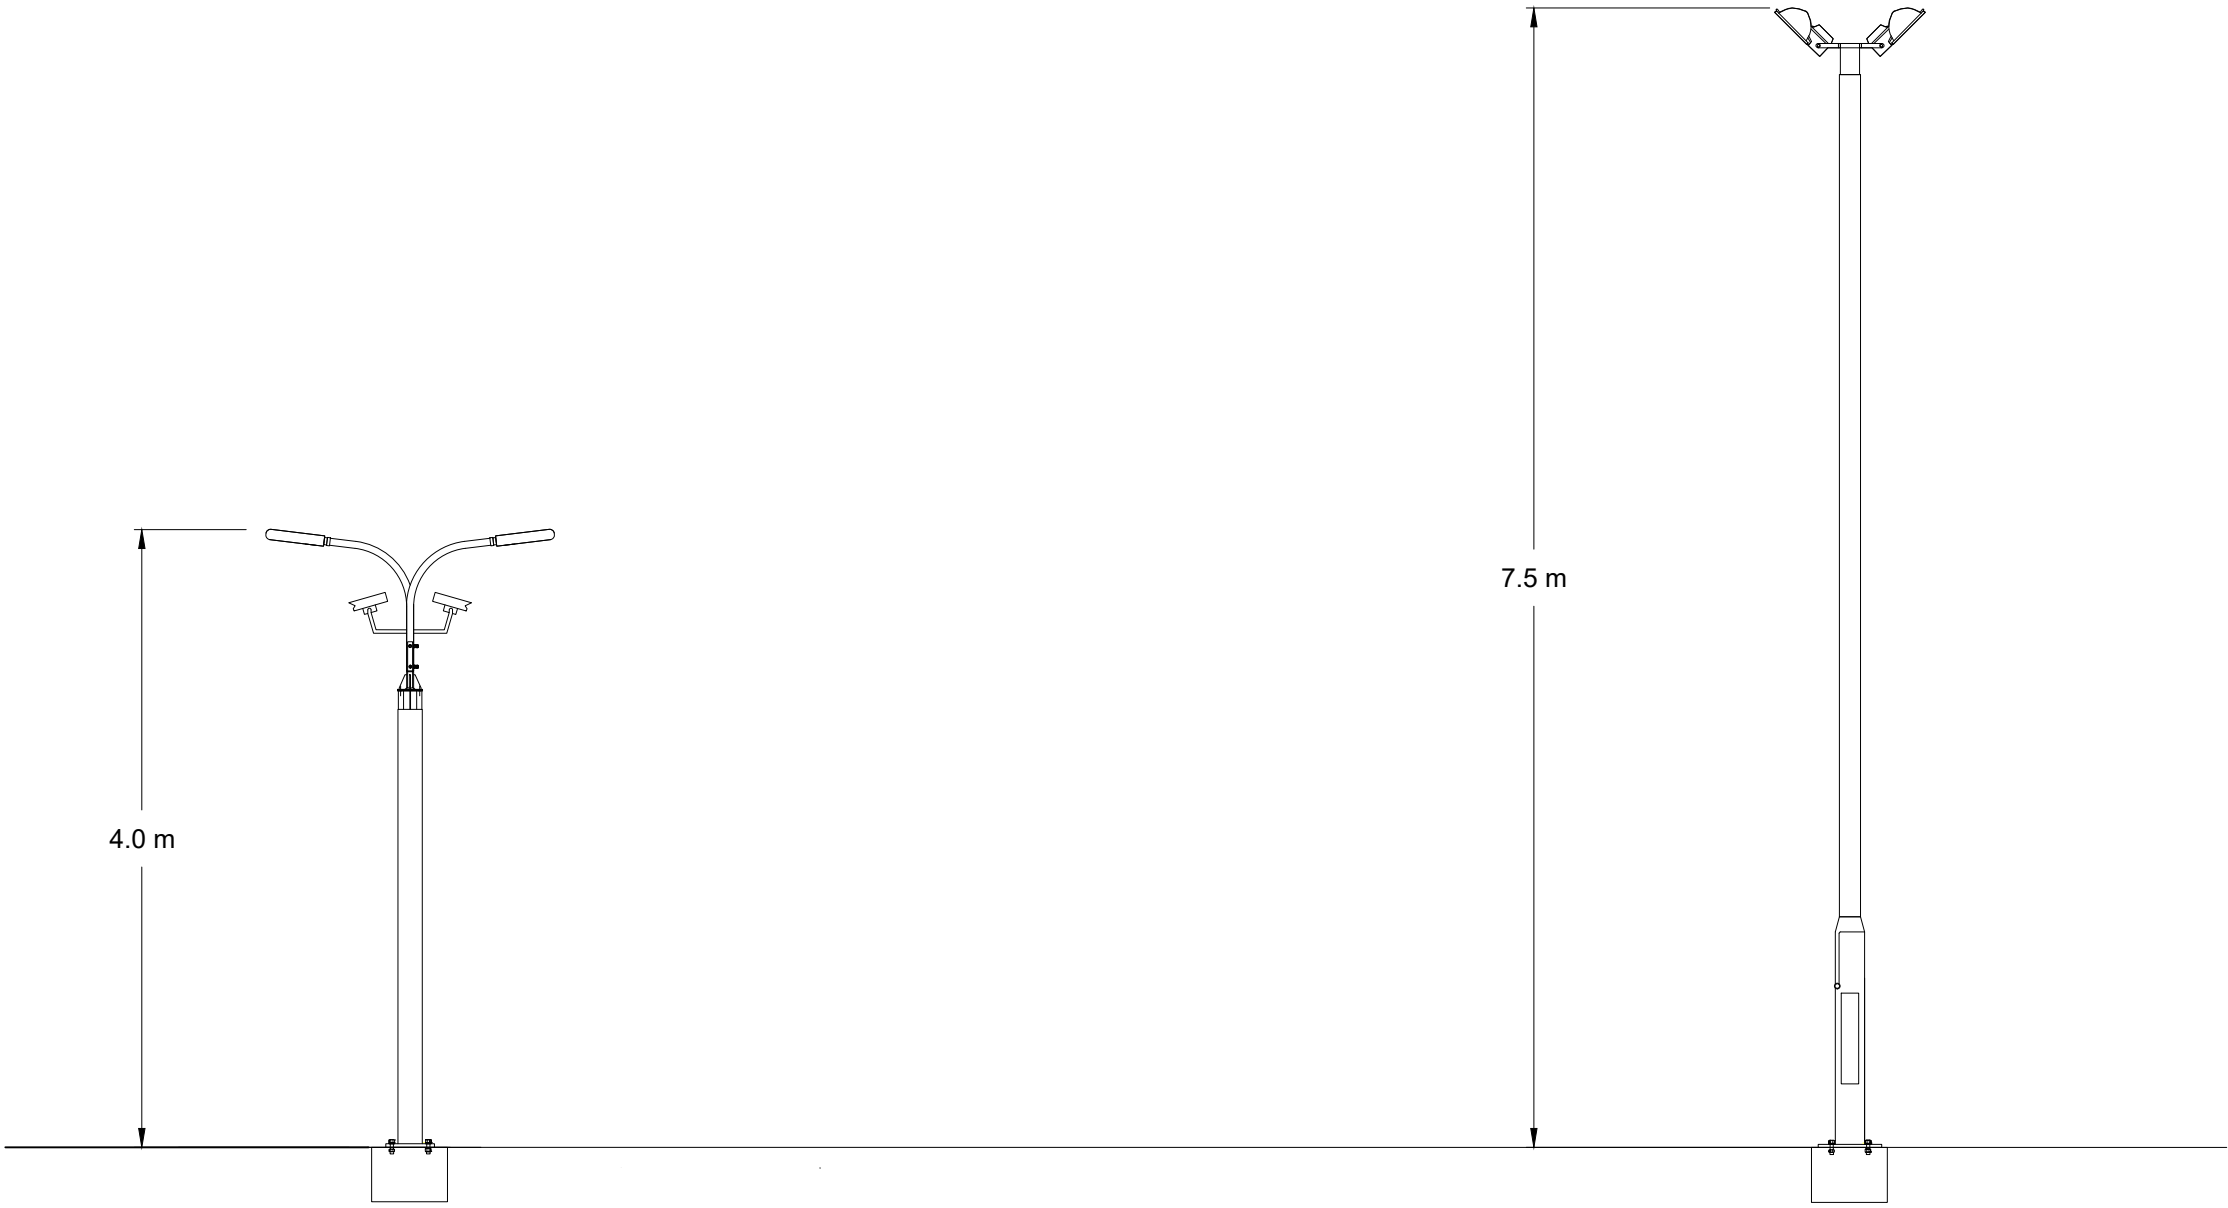

BESS AREA LIGHTING / CCTV COLUMN DETAIL

SUBSTATION EXTENSION COLUMN DETAIL

